


Typical Trench Detail For Customer Supplied Service Line Trench

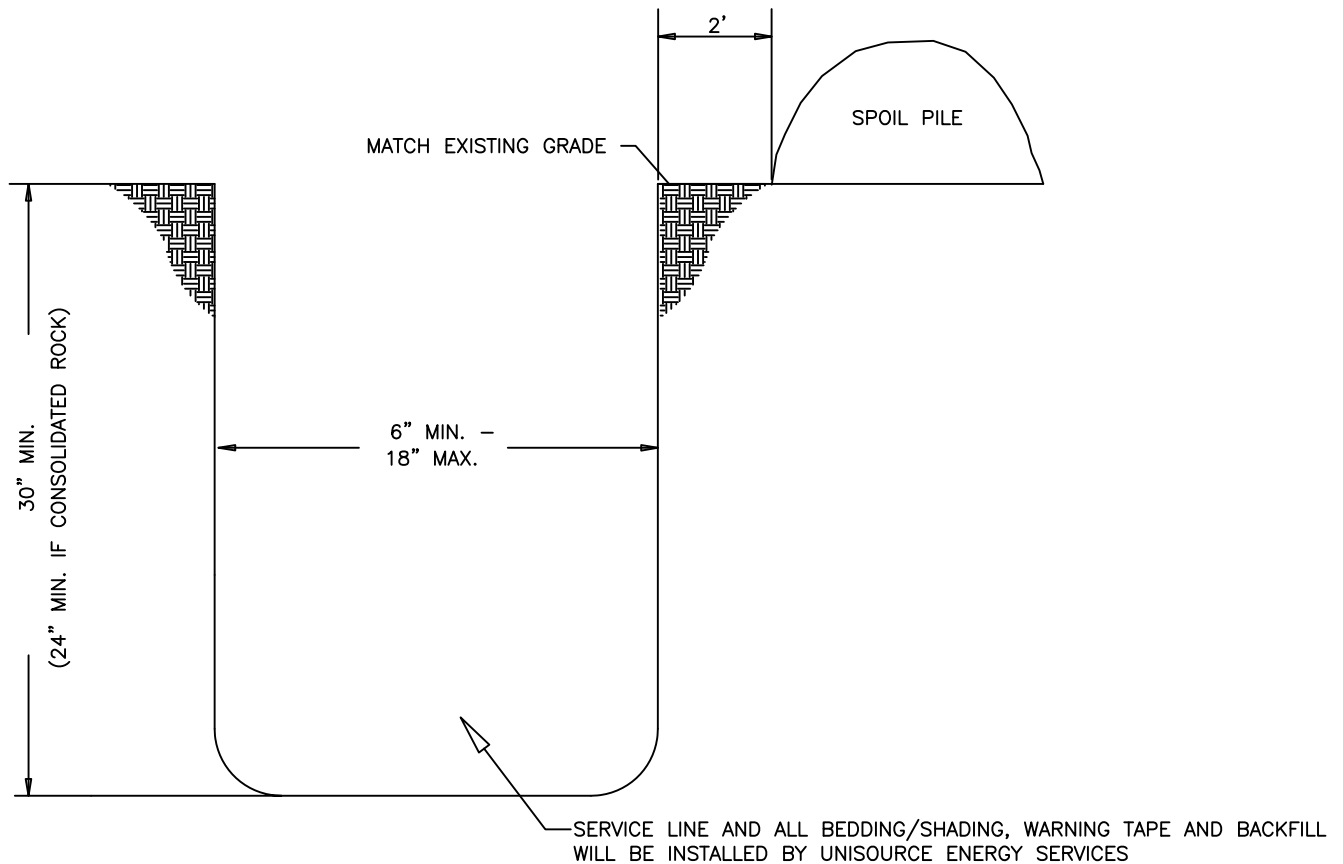

C TYPICAL CUSTOMER SUPPLIED TRENCH DETAIL

TYP NO SCALE

NOTE:

- 1) TYPICAL TRENCH WIDTH SHALL BE A MINIMUM 6", AND NO WIDER THAN 18".
- 2) TRENCH TO MEET APPLICABLE OSHA REQUIREMENTS.
- 3) CUSTOMER MAY BE CHARGED FOR EXTRA TRENCH WIDTH OR DEPTH.

UniSource Energy Services Engineering Department	
TYPICAL CUSTOMER SUPPLIED TRENCH DETAIL	
DRAWN BY: DCJ	PAGE 1 OF 1
DATE: 2-2017	
SCALE: N.T.S.	